
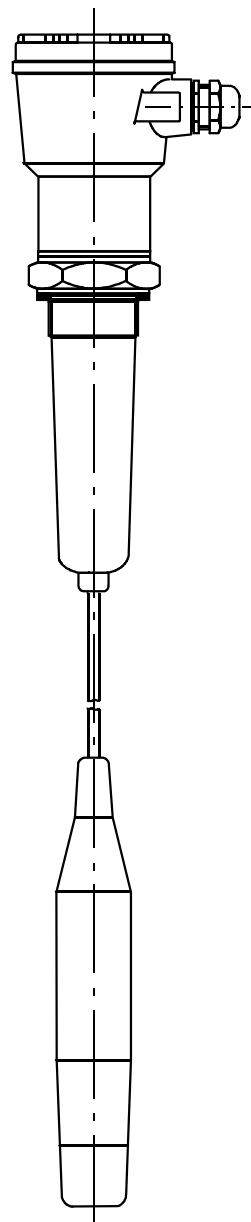


nivocompact FTC 831 Level Limit Switch

Installation and Operating Manual

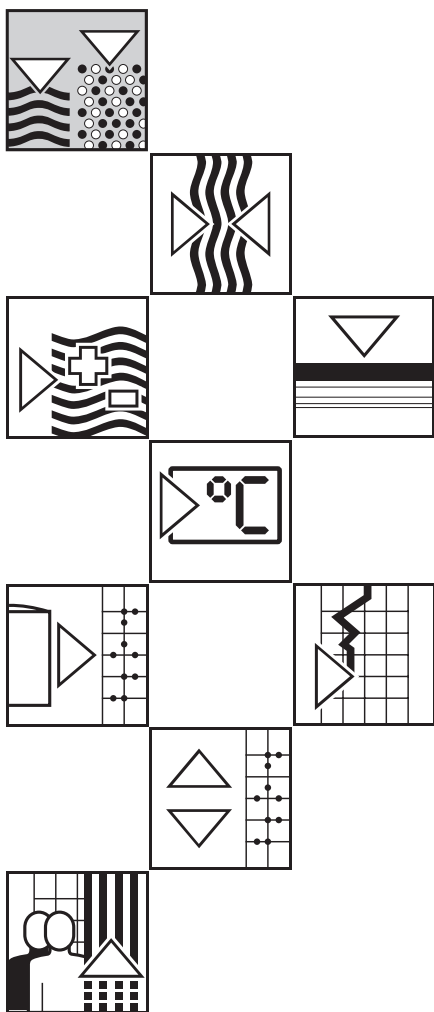

Contents	Page
Application	3
Application Examples	3
Technical Data	4
The Measuring System	7
Function	8
Installation	9
Project Planning	9
Examples for Mounting	10
Mounting	11
Type key	11
Connection	13
Wiring Connection	13
EC 40 (Two-Wire Connection) for AC	14
EC 42 (Three-Wire PNP) for DC	15
EC 43 (Three-Wire NPN) for DC	16
EC 44 (Relay output) for DC and AC	17
Wiring On-Site	18
Calibration	19
Switching Delay	19
Safety Switching	20
Special Applications	21
Function Control	23
Maintenance	23
Troubleshooting	23
Replacement of Parts	25
Returning Parts for Repair	25
Shortening the Cable	26

Application

The Nivocompact FTC 831 is used for limit detection in silos containing bulk solids (for minimum or maximum indication).
Also for use in the food processing industry.
For mounting in silos from above.

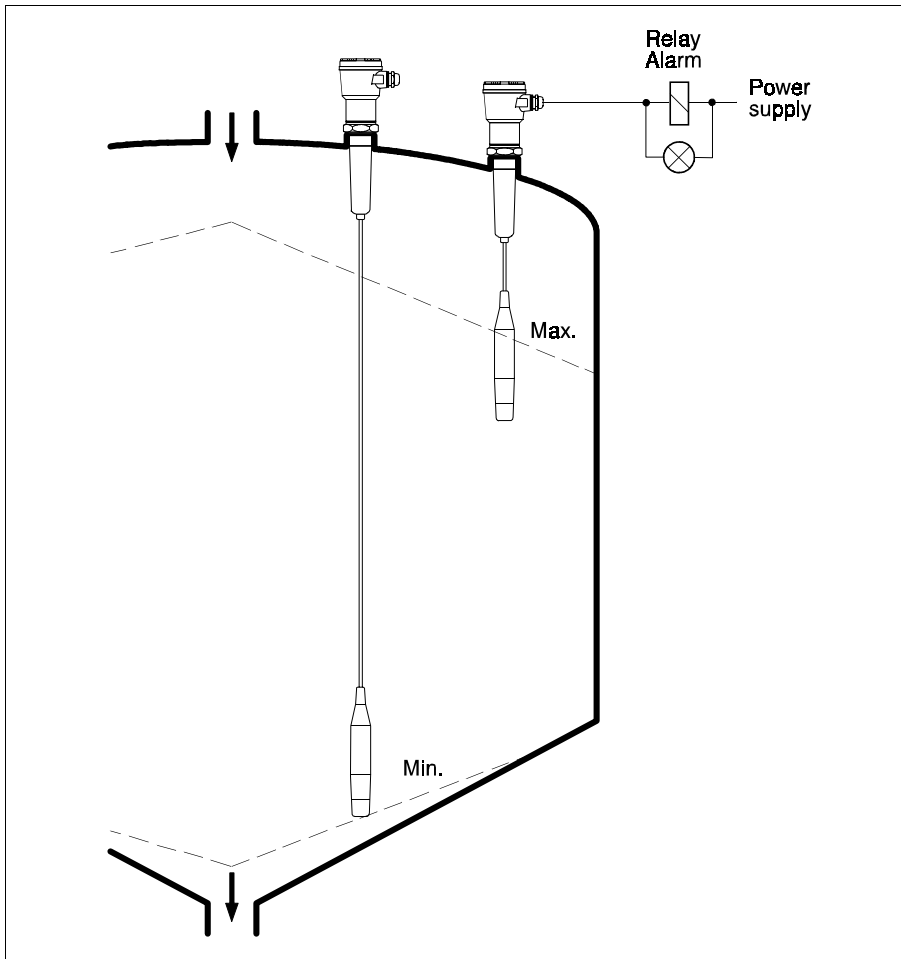


Fig. 1
Limit detection in bulk solid silos with the capacitive level limit switch Nivocompact FTC 831.

Application Examples

Lime	Kaolin	Grain	Spices
Plaster	Plastic	Flour	Semolina
Cement	granulates		Fodder
and similar bulk solids			

Note:
Bulk solids should have dielectric constants $\epsilon_r \geq 1.6$.

Please contact us for advice if the dielectric constant of the bulk solid is not known.

以上内容仅为本文档的试下载部分，为可阅读页数的一半内容。如要下载或阅读全文，请访问：<https://d.book118.com/717161120051006116>